



DESCRIPTION	
1	LV BUSH. & 4 HOLE SPADE
3	1/2-13 GROUND PAD
4	HV BUSH DF WELL
5	LOAD BREAK PKG STAND
7	NP ON DOOR SER ON TANK
8	TANK
9	COOLING RADIATORS
10	HANDHOLE & SECURITY COVER
12	LIFTING LUGS
13	JACKING PROVISIONS
14	1/2-13 GROUND PAD
15	1 IN DRAIN VALVE AND SAMPLER
21	PAD LOCKABLE DOOR HANDLE
22	3 POINT LATCH HEX SEC BOLT
24	12 IN REMOVABLE SILL
25	METAL LV-HV BARRIER
39	DRIP SHIELD
41	BAYONET FUSE HOLDER
43	LOADBREAK SWITCH
47	PRESS. REL VALVE
48	DIAL THERM W/MAX POINTER
49	2" MAG LL GAUGE: LV COMP
50	OIL LEVEL PLUG
51	TAP CHANGER HANDLE
57	PROVISION FOR PRES VAC GAUGE
SPECIAL NOTES	
A BAY-O-NET FUSE	
RTE4000353C10	
C ISOLATION LINK FUSE	
HI A03	
E	
CAT NO 9180435155045	
DWG BY: RH DATE: 08/23/95	
APP BY: CC. 745	

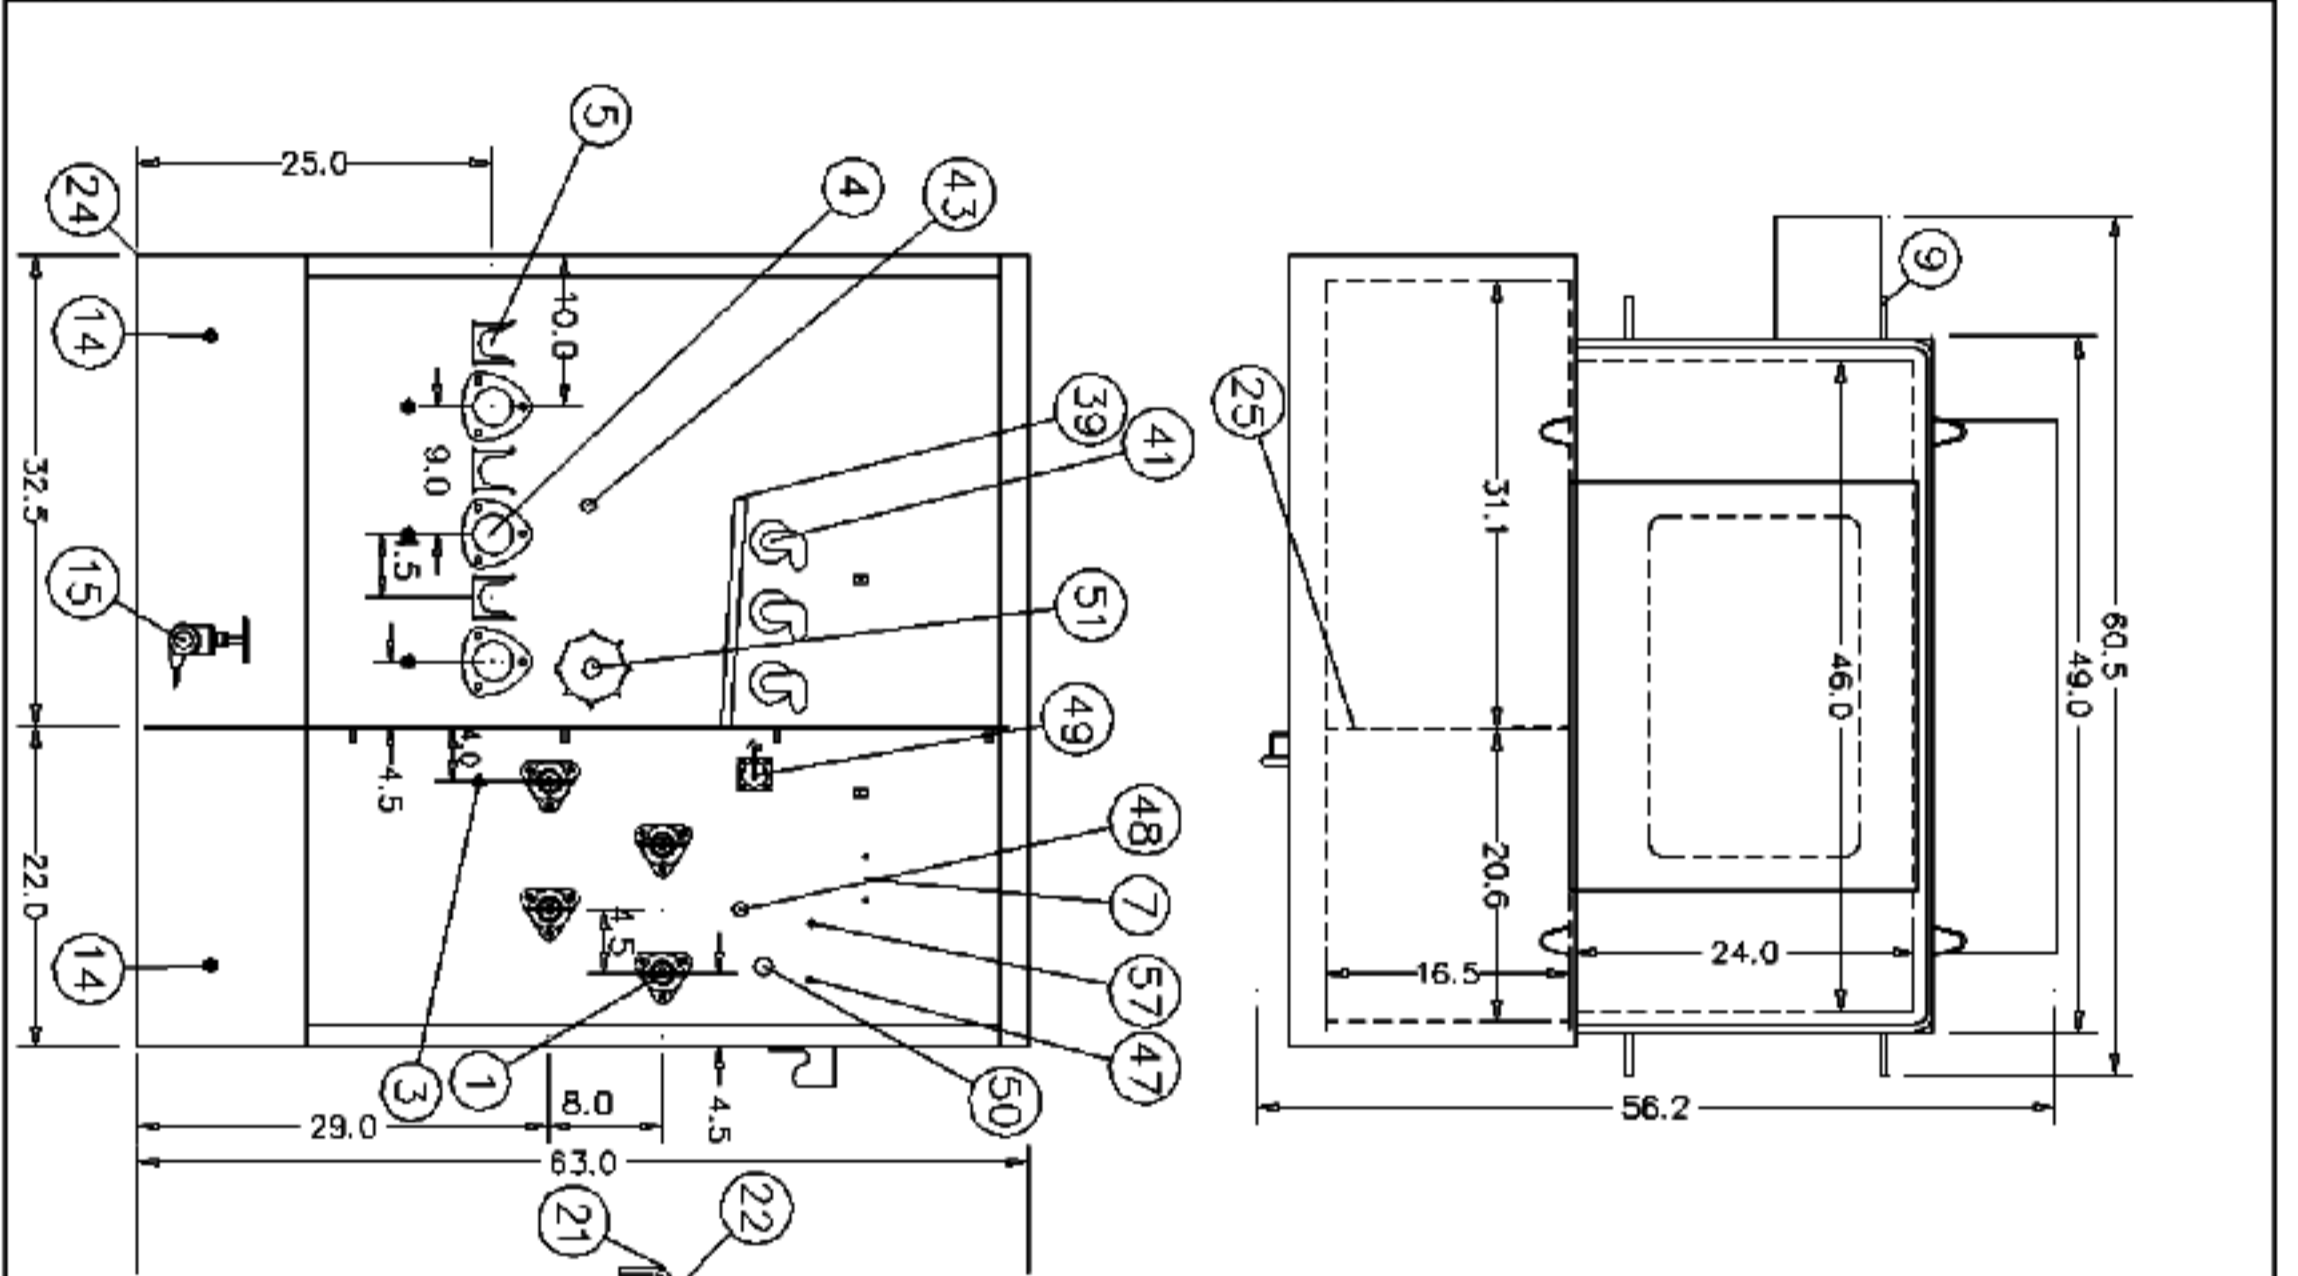

DWG NO.	0073695051.025		
 SUNBELT TRANSFORMER TEMPLE, TEXAS			
CUSTOMER :	SUNBELT TRANSFORMER INC., TX		
SPEC.	DATED		
KVA	300.0BIL 95 TAPS SPECIAL Z		
HIGH VOLTAGE	14400		
LOW VOLTAGE	480Y/277		
APPROX. CORE AND COIL WEIGHT	1152		
APPROX. TANK AND ACCESS. WEIGHT	1162		
GAL. DF OIL	187 ; APPROX. WEIGHT 1403		
APPROX. TOTAL WEIGHT	3717		
REV.	DATE	DESCRIPTION	BY
A			APP
ID	3RLHCJ15	P.N. 0073695051.025	

10 GA. MILD STEEL TANK

0.052

91805901Z,CB, 21, 1.S34, 2, 2, EK

474624,635469,0, 643,2, 3963

59036746,010