


**A155F1DORO - 10E to 50E and A155F2DORO - 65E to 100E**

**Total Clearing Time - Current Data, 15.5kV Fuses**

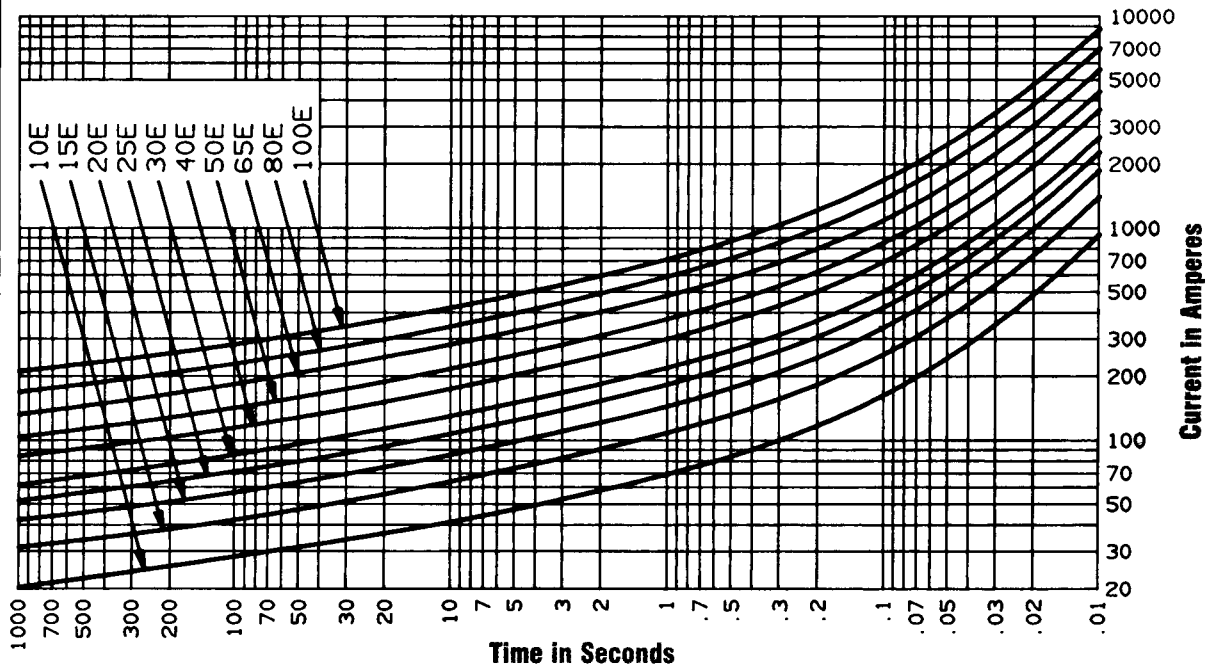

**A155F1DORO - 10E to 50E and A155F2DORO - 65E to 100E**

**Minimum Melting Time - Current Data, 15.5kV Fuses**

